


NOT TO SCALE


EXTERIOR WALL MOUNTED

CAMERA MOUNTING DETAIL

PLASTIC INSULATING BUSHING-

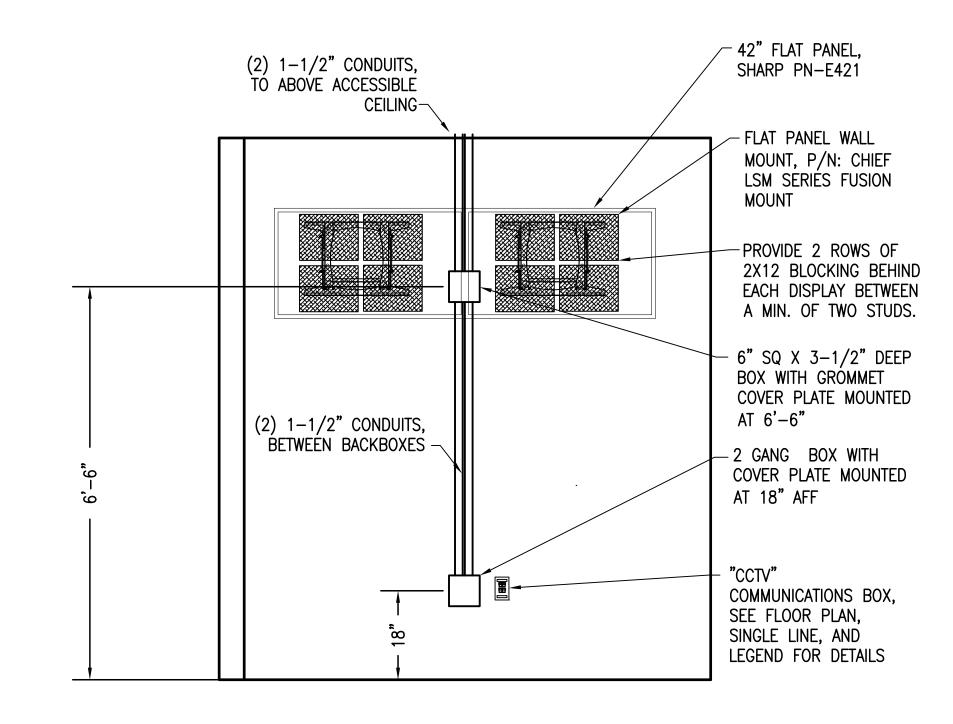

CCTV CAMERA VIEWING MONITORS DETAIL TY502 NOT TO SCALE

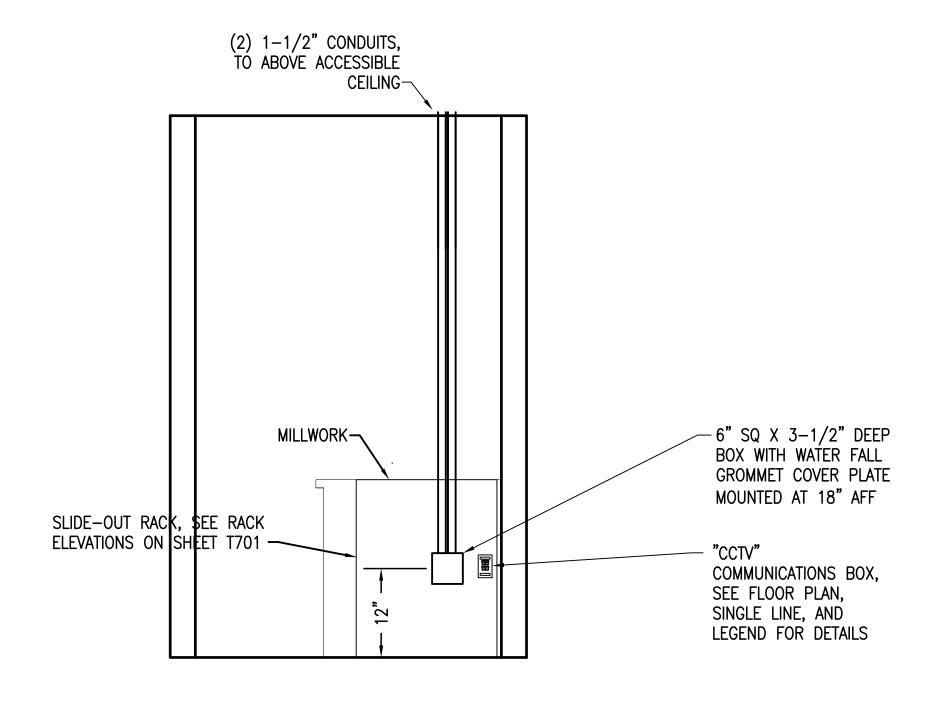

CAT 6 CABLE RUN

DOME CAMERA ENCLOSURE

ACOUSTIC TILE CEILING

- INDOOR PTZ DOME CAMERA

(IF APPLICABLE)

INTERIOR CEILING MOUNTED CAMERA MOUNTING DETAIL

TY502 NOT TO SCALE


/ INDEPENDENTLY SUPPORT BACKCAN

-3/4" CONDUIT

MILLWORK CABINET RACK BACKBOX ROUGH—IN DETAIL TY502 NOT TO SCALE

## FINAL SUBMISSION / FULLY SPRINKLERED

Dwg. 4 of 6

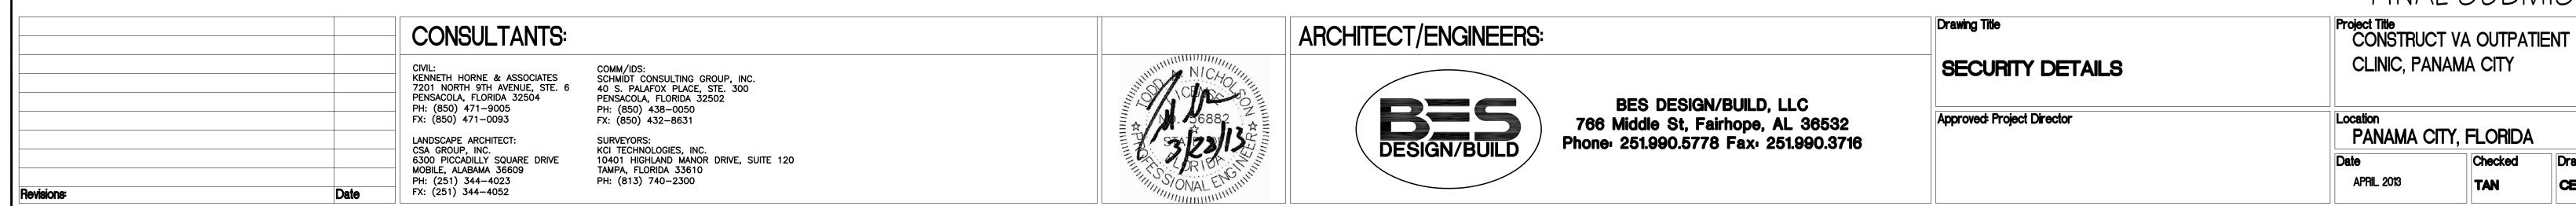

VA FORM 08-6231

520-326 **Building Number** Drawing Number TY502

Office of Construction and Facilities Management

Department of Veterans Affai